
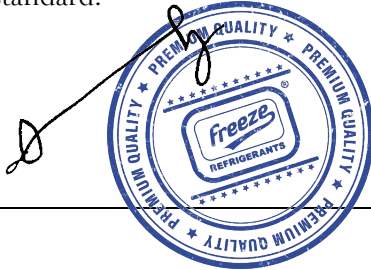




## Certificate of Analysis

Product: R410A  
Batch No: R410A190624012  
Product Date: 2019.6.24

Standard: AHRI 700-2017  
Source of Sample: Cylinder  
Inspection Date: 2019.6.24

Inspection Items	AHRI 700-2017	Results
R32	48.5 – 50.5%	49.98%
R125	49.5 – 51.5%	50.02%
Product Appearance	Visually clean	Pass
Particulates/solids	Visually clean	Pass
Purity	99.5%	99.96%
Moisture, Maximum	10ppm	8ppm
Acidity, Maximum (as HCL)	1ppm	<0.1ppm
Chloride, Maximum	No visible turbidity	Pass
Evaporating residue, Maximum	0.01%	<0.01%
Non-condensable gas, Maximum	1.5%	<1.5%
Conclusion: Superior grade, confirmed as per AHRI 700-2017 standard.		
 		
Remark:		

### FREEZE REFRIGERANTS

Corporate Office: #05-01, Grand Building,  
Grand Building, 17 Phillip Street, Singapore 048695  
Email: sales@freezeref.com Web: www.freezeref.com